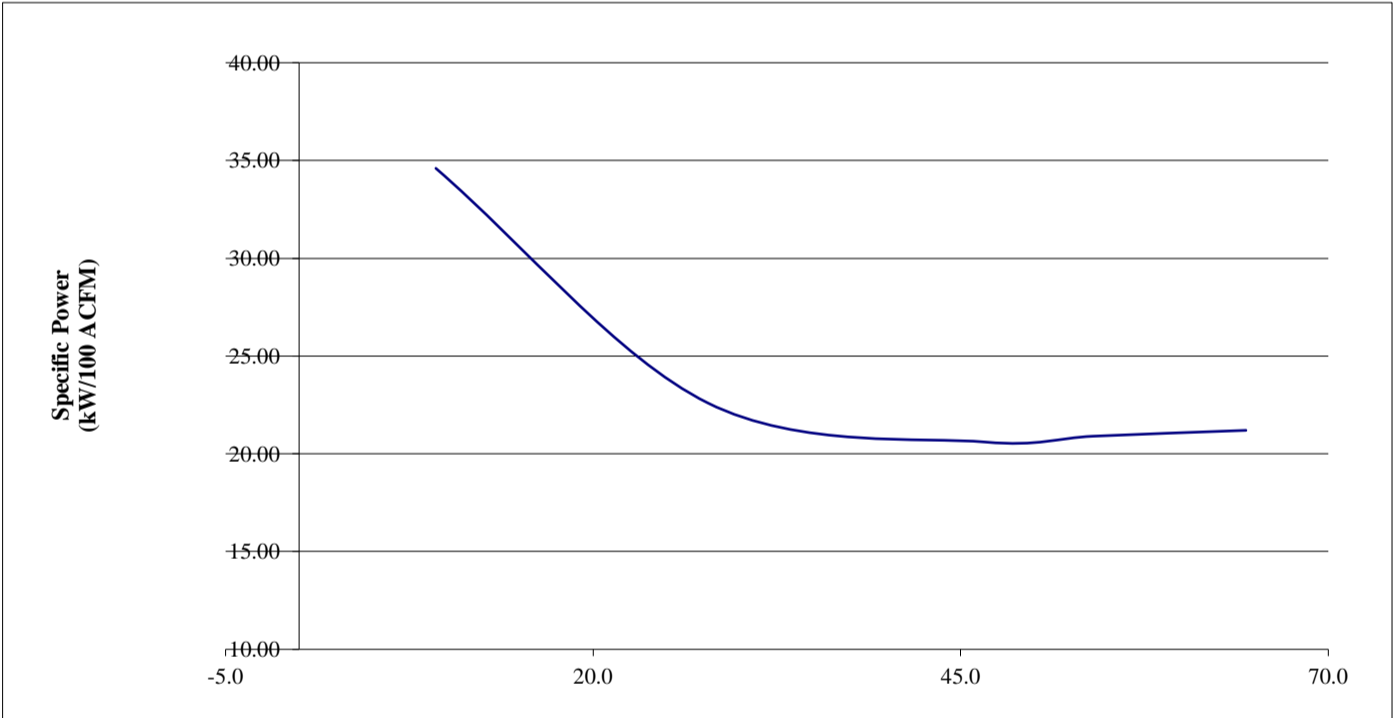


COMPRESSOR DATA SHEET

Rotary Compressor: Variable Displacement

MODEL DATA - FOR COMPRESSED AIR

1	Manufacturer: Chicago Pneumatic		
2	Model Number: CPVsd 15		Date: 02/15/16
	<input checked="" type="checkbox"/> Air-cooled <input type="checkbox"/> Water-cooled		Type: Screw
	<input checked="" type="checkbox"/> Oil-injected <input type="checkbox"/> Oil-free		# of Stages: 1
3	Rated Operating Pressure	100	psig ^b
4	Drive Motor Nominal Rating	15	hp
5	Drive Motor Nominal Efficiency	91.0	percent
6	Fan Motor Nominal Rating (if applicable)	N/A	hp
7	Fan Motor Nominal Efficiency	N/A	percent
8*	Input Power (kW)	Capacity (acfm) ^{a,d}	Specific Power (kW/100 acfm) ^d
	14.1 Max	64.4	21.20
	11.7	54.0	20.90
	9.9	46.7	20.60
	6.5	27.8	22.60
	3.3 Min	9.3	34.60
9*	Total Package Input Power at Zero Flow ^{c, d}		0.0 kW
10	 <p style="text-align: center;">Note: Graph is only a visual representation of the data in Section 8 Note: Y-Axis Scale, 10 to 35, + 5kW/100acfm increments if necessary above 35 X-Axis Scale, 0 to 25% over maximum capacity</p>		

*For models that are tested in the CAGI Performance Verification Program, these items are verified by the third party administrator. Consult CAGI website for a list of participants in the third party verification program: www.cagi.org

NOTES:

- a. Measured at the discharge terminal point of the compressor package in accordance with ISO 1217, Annex E; ACFM is actual cubic feet per minute at inlet conditions.
- b. The operating pressure at which the Capacity and Electrical Consumption were measured for this data sheet.
- c. No Load Power. In accordance with ISO 1217, Annex E, if measurement of no load power equals less than 1%, manufacturer may state "not significant" or "0" on the test report.
- d. Tolerance is specified in ISO 1217, Annex E, as shown in table below:
 NOTE: The terms "power" and "energy" are synonymous for purposes of this document.



Member

Volume Flow Rate at specified conditions		Volume Flow Rate	Specific Energy Consumption	No Load / Zero Flow Power
<u>m³ / min</u>	<u>ft³ / min</u>	%	%	
Below 0.5	Below 15	+/- 7	+/- 8	+/- 10%
0.5 to 1.5	15 to 50	+/- 6	+/- 7	
1.5 to 15	50 to 500	+/- 5	+/- 6	
Above 15	Above 500	+/- 4	+/- 5	