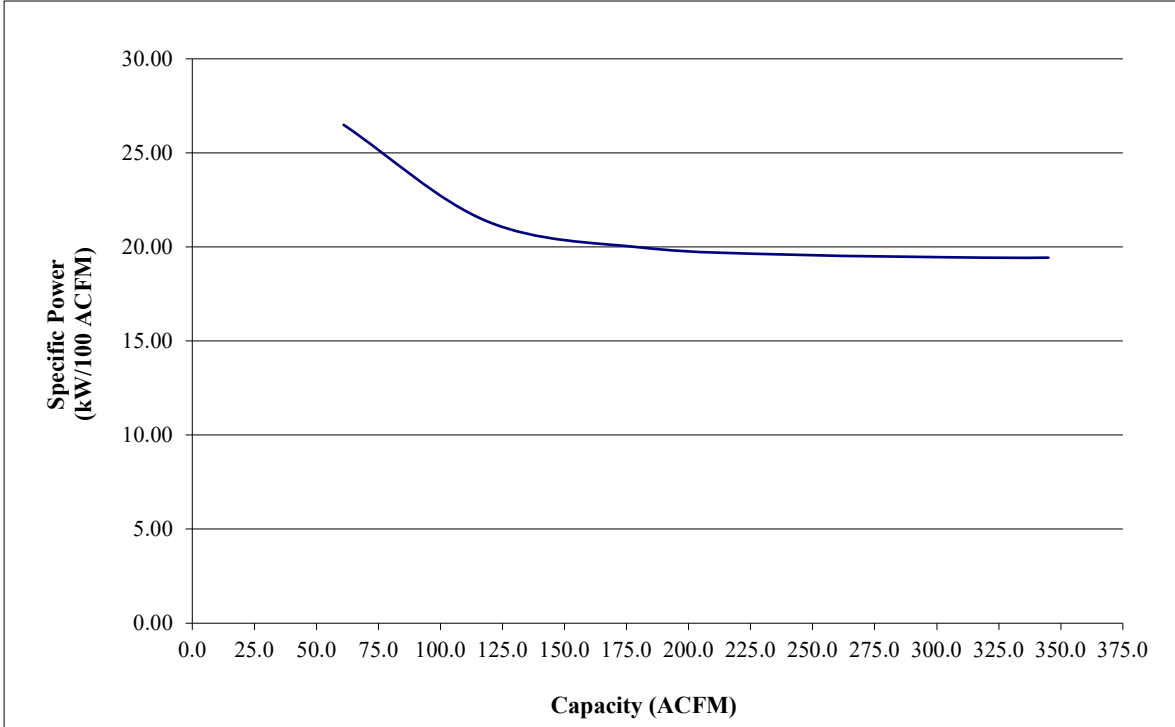


**Rotary Compressor: Variable Frequency Drive**

MODEL DATA - FOR COMPRESSED AIR			
1	Manufacturer: <b>Chicago Pneumatic</b>		
2	Model Number: <b>CPVS 75 PM</b>	Date: <b>Jun-19</b>	
	<input checked="" type="checkbox"/> Air-cooled <input type="checkbox"/> Water-cooled	Type: <b>Screw</b>	
	<input checked="" type="checkbox"/> Oil-injected <input type="checkbox"/> Oil-free	# of Stages: <b>1</b>	
3	Rated Operating Pressure	<b>138</b>	psig <sup>b</sup>
4	Drive Motor Nominal Rating	<b>100</b>	hp
5	Drive Motor Nominal Efficiency	<b>96</b>	percent
6	Fan Motor Nominal Rating (if applicable)	<b>3.5</b>	hp
7	Fan Motor Nominal Efficiency	<b>87.5</b>	percent
8*	Input Power (kW)	Capacity (acfm) <sup>a,d</sup>	Specific Power (kW/100 acfm) <sup>d</sup>
	67.0 Max	<b>345.0</b>	<b>19.43</b>
	62.2	<b>320.0</b>	<b>19.43</b>
	47.6	<b>243.0</b>	<b>19.58</b>
	36.3	<b>182.0</b>	<b>19.96</b>
	25.4	<b>119.0</b>	<b>21.35</b>
	16.2 Min	<b>61.0</b>	<b>26.49</b>
9*	Total Package Input Power at Zero Flow <sup>c, d</sup>	<b>0.0</b>	kW
10	 <p style="text-align: center;"> <b>Note: Graph is only a visual representation of the data in Section 8</b>            Note: Y-Axis Scale, 10 to 35, + 5kW/100acfm increments if necessary above 35            X-Axis Scale, 0 to 25% over maximum capacity         </p>		

\*For models that are tested in the CAGI Performance Verification Program, these items are verified by program administrator

Consult CAGI website for a list of participants in the third party verification program: [www.cagi.org](http://www.cagi.org)

NOTES:

- Measured at the discharge terminal point of the compressor package in accordance with ISO 1217, Annex E; acfm is actual cubic feet per minute at inlet conditions.
- The operating pressure at which the Capacity and Electrical Consumption were measured for this data sheet.
- No Load Power. In accordance with ISO 1217, Annex E, if measurement of no load power equals less than 1%, manufacturer may state "not significant" or "0" on the test report.
- Tolerance is specified in ISO 1217, Annex E, as shown in table below:

NOTE: The terms "power" and "energy" are synonymous for purposes of this document.



Volume Flow Rate at specified conditions		Volume Flow Rate	Specific Energy Consumption	No Load / Zero Flow Power
$\text{m}^3 / \text{min}$	$\text{ft}^3 / \text{min}$	%	%	
Below 0.5	Below 15	+/- 7	+/- 8	+/- 10%
0.5 to 1.5	15 to 50	+/- 6	+/- 7	
1.5 to 15	50 to 500	+/- 5	+/- 6	
Above 15	Above 500	+/- 4	+/- 5	