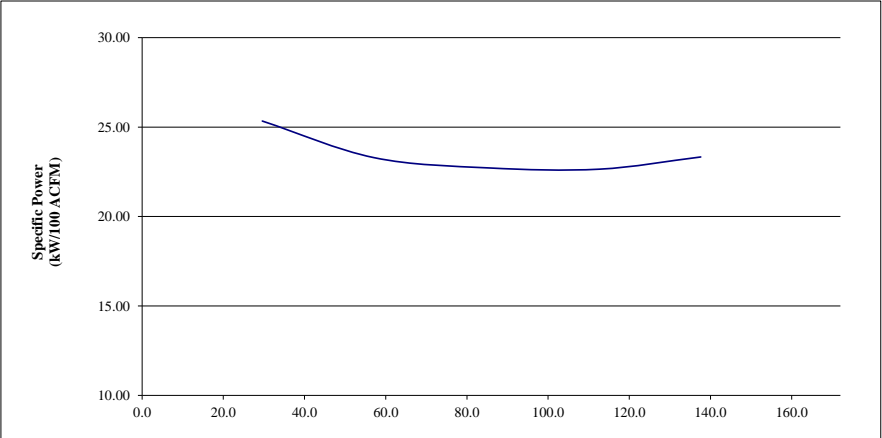


## COMPRESSOR DATA SHEET

### Rotary Compressor: Variable Displacement

#### MODEL DATA - FOR COMPRESSED AIR

1	Manufacturer:	<b>Chicago Pneumatic</b>		
2	Model Number:	<b>CPVSd 34</b>	Date:	<b>Oct-19</b>
	<input checked="" type="checkbox"/> Air-cooled <input type="checkbox"/> Water-cooled		Type:	<b>Screw</b>
	<input checked="" type="checkbox"/> Oil-injected <input type="checkbox"/> Oil-free		# of Stages:	<b>1</b>
3	Rated Operating Pressure	<b>125</b>	psig <sup>b</sup>	
4	Drive Motor Nominal Rating	<b>35</b>	hp	
5	Drive Motor Nominal Efficiency	<b>92.4</b>	percent	
6	Fan Motor Nominal Rating (if applicable)	<b>N/A</b>	hp	
7	Fan Motor Nominal Efficiency	<b>N/A</b>	percent	
8*	Input Power (kW)	Capacity (acfm) <sup>a,d</sup>	Specific Power (kW/100 acfm) <sup>d</sup>	
	32.1	<b>137.6</b>	<b>23.33</b>	
	25.5	<b>112.6</b>	<b>22.65</b>	
	19.4	<b>85.4</b>	<b>22.72</b>	
	13.3	<b>57.1</b>	<b>23.29</b>	
	7.5	Min	<b>29.6</b>	<b>25.34</b>
9*	Total Package Input Power at Zero Flow <sup>c, d</sup>		<b>0.0</b>	kW
10	 <p style="text-align: center; font-size: small;"> <b>Note: Graph is only a visual representation of the data in Section 8</b>                      Note: Y-Axis Scale, 10 to 30, + 5kW/100acfm increments if necessary above 35                      X-Axis Scale, 0 to 25% over maximum capacity                 </p>			

\*For models that are tested in the CAGI Performance Verification Program, these items are verified by the third party administrator. Consult CAGI website for a list of participants in the third party verification program: [www.cagi.org](http://www.cagi.org)

**NOTES:**

- a. Measured at the discharge terminal point of the compressor package in accordance with ISO 1217, Annex E; ACFM is actual cubic feet per minute at inlet conditions.
- b. The operating pressure at which the Capacity and Electrical Consumption were measured for this data sheet.
- c. No Load Power. In accordance with ISO 1217, Annex E, if measurement of no load power equals less than 1%, manufacturer may state "not significant" or "0" on the test report.
- d. Tolerance is specified in ISO 1217, Annex E, as shown in table below:  
NOTE: The terms "power" and "energy" are synonymous for purposes of this document.



Member

Volume Flow Rate at specified conditions		Volume Flow Rate	Specific Energy Consumption	No Load / Zero Flow Power
m <sup>3</sup> / min	ft <sup>3</sup> / min	%	%	
Below 0.5	Below 15	+/- 7	+/- 8	+/- 10%
0.5 to 1.5	15 to 50	+/- 6	+/- 7	
1.5 to 15	50 to 500	+/- 5	+/- 6	
Above 15	Above 500	+/- 4	+/- 5	